
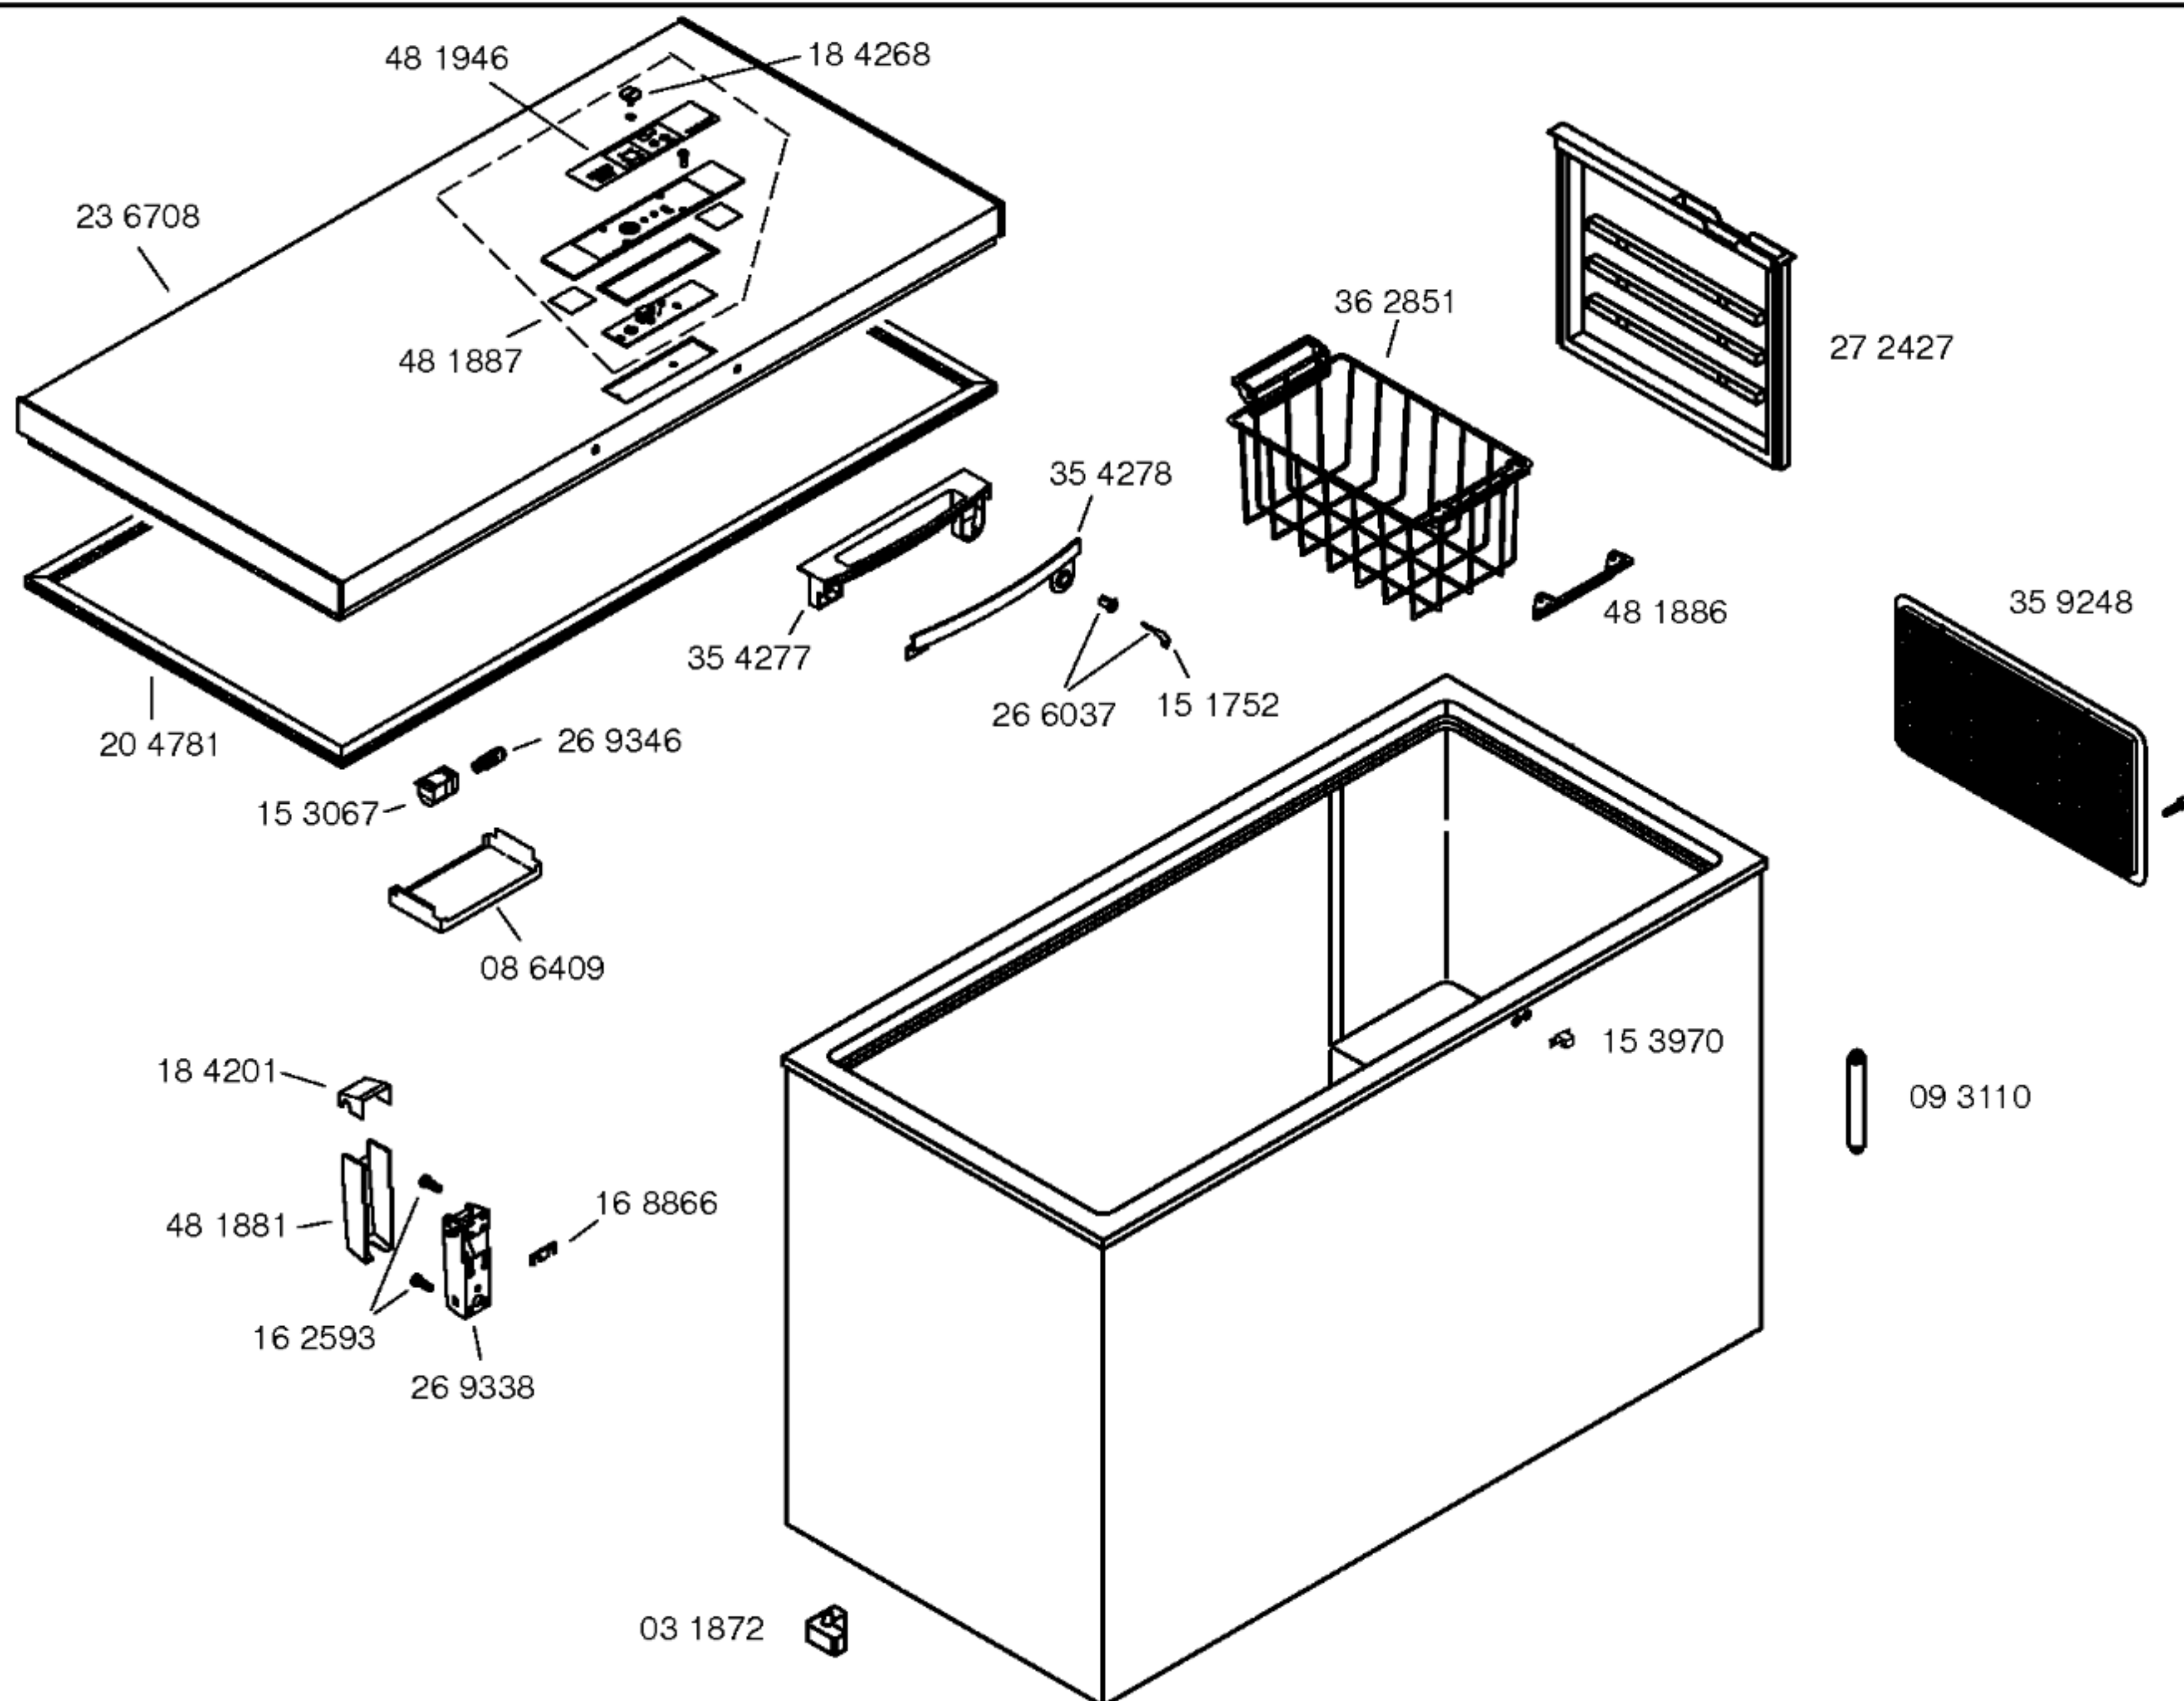


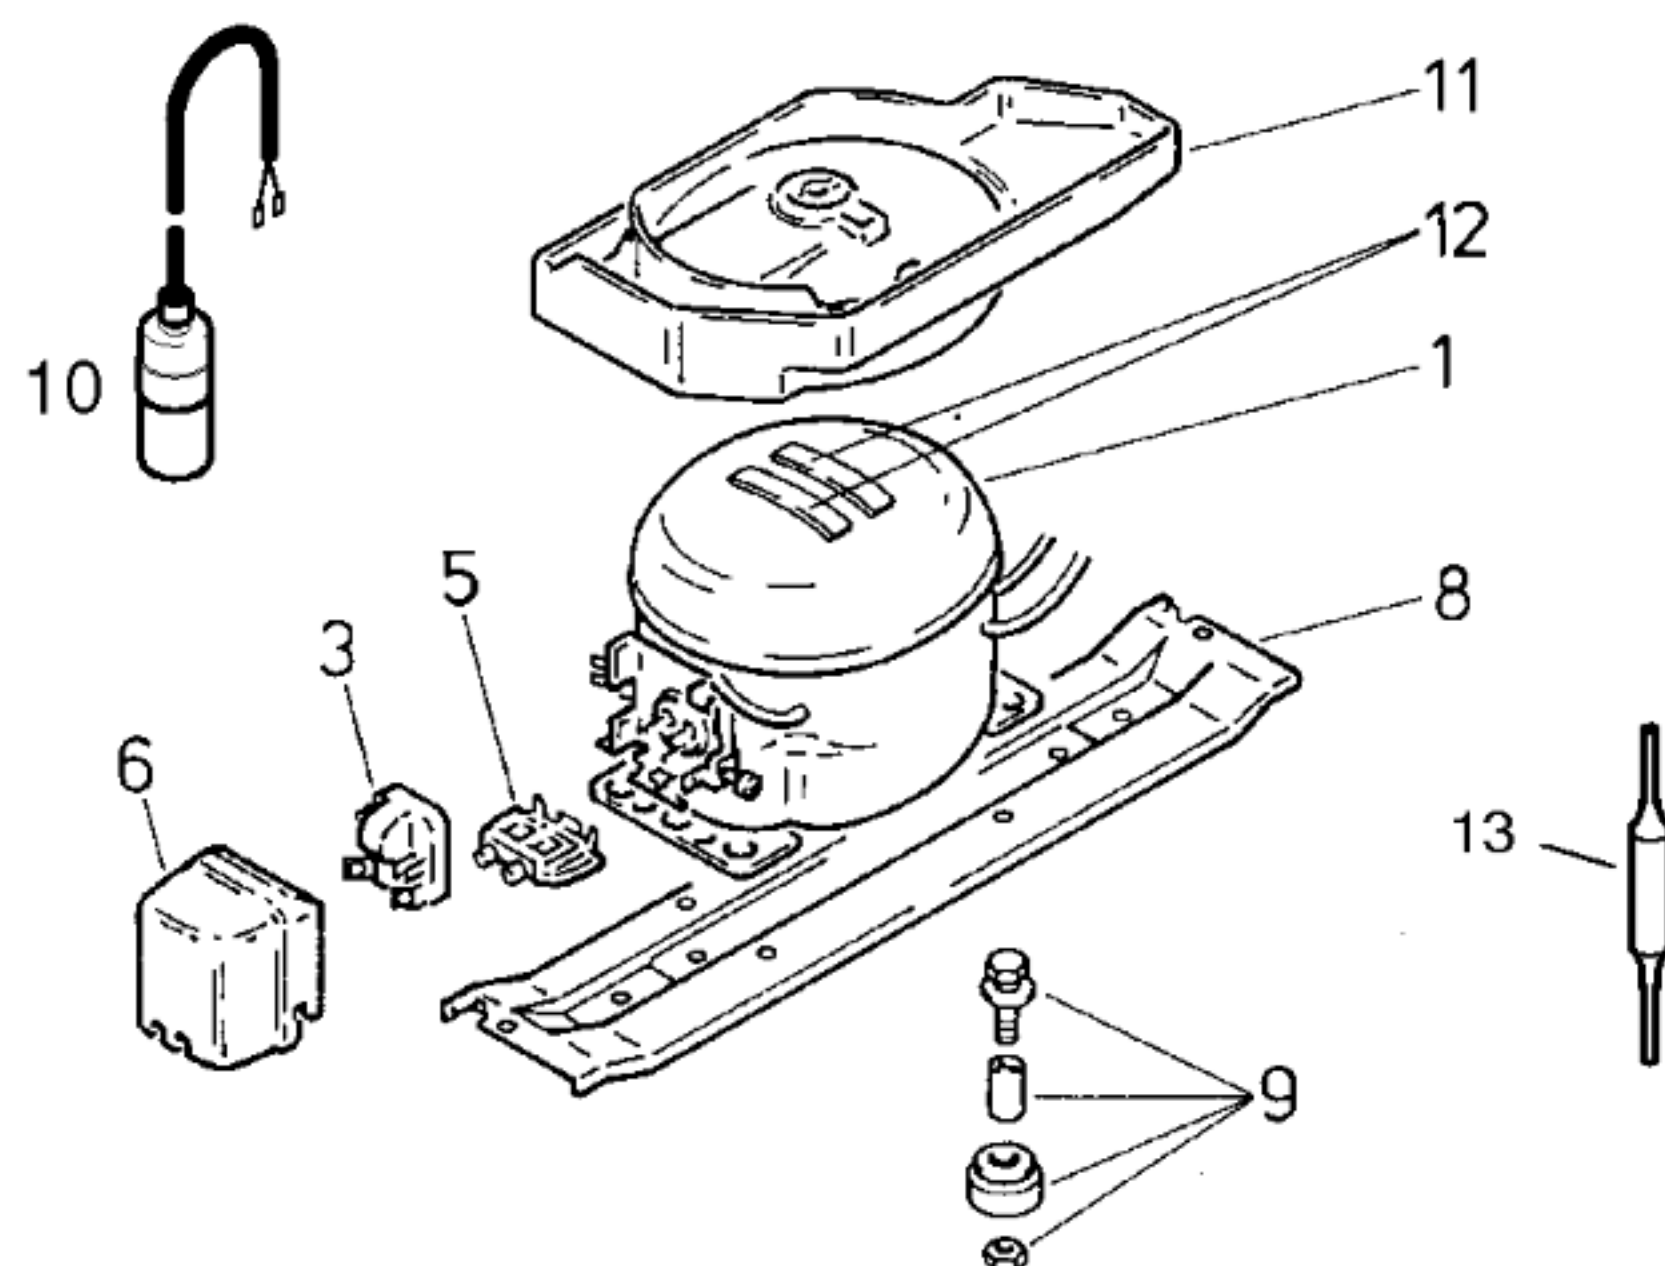

Mat. - Nr. - Konstante
3740
Gebrauchsanweisung
52 9304
(D,GB,F,I,NL,TR)

Ident – Nummern – Konstante
3740

	V01	V02	
Pos.	Zanussi HLY75AA	Danfoss TLES8KK2	
1	14 2049	14 2049	
2			
3	18 4226	15 1055	
4			
5	15 3080	15 0760	
6	15 3079	15 1072	
7			
8			
9	15 3069	15 3069	
10			
11			
12			
13			

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES			
Verdichter/Compressor/Compresseur Typ/Type Förderleistung/Delivery/Débit Anlaufstrom/Starting current/Cour de démarrage Widerstand/Resistance/Résistance Ha/main/prin Hi/aux	 l/h A Ω Ω	Zanussi HLY75AA	Danfoss TLES8KK2
Temp.-Regler/Thermostat Typ/Type Regelstellung/Position Schaltwerte/Switching values Valeurs de commutation	 "warm" "kalt" "alarm"		
Füllmenge/Fill.quantity/Charge	R600a		
Anschlußwert/Conn.load/Puiss. connectée	W		
Heizung/Heater/Chauffage Widerstand/Resistance/Résistance Leistung/Power/Puissance	 Ω W		
Ventilator/Blower/Ventilateur Widerstand/Resistance/Résistance	Ω		
Temp.-Regler/Thermostat			
Magnetventil/Magnetic valve/Electrovanne Widerstand/Resistance/Résistance Spannung/Voltage/Tension	 Ω V		