



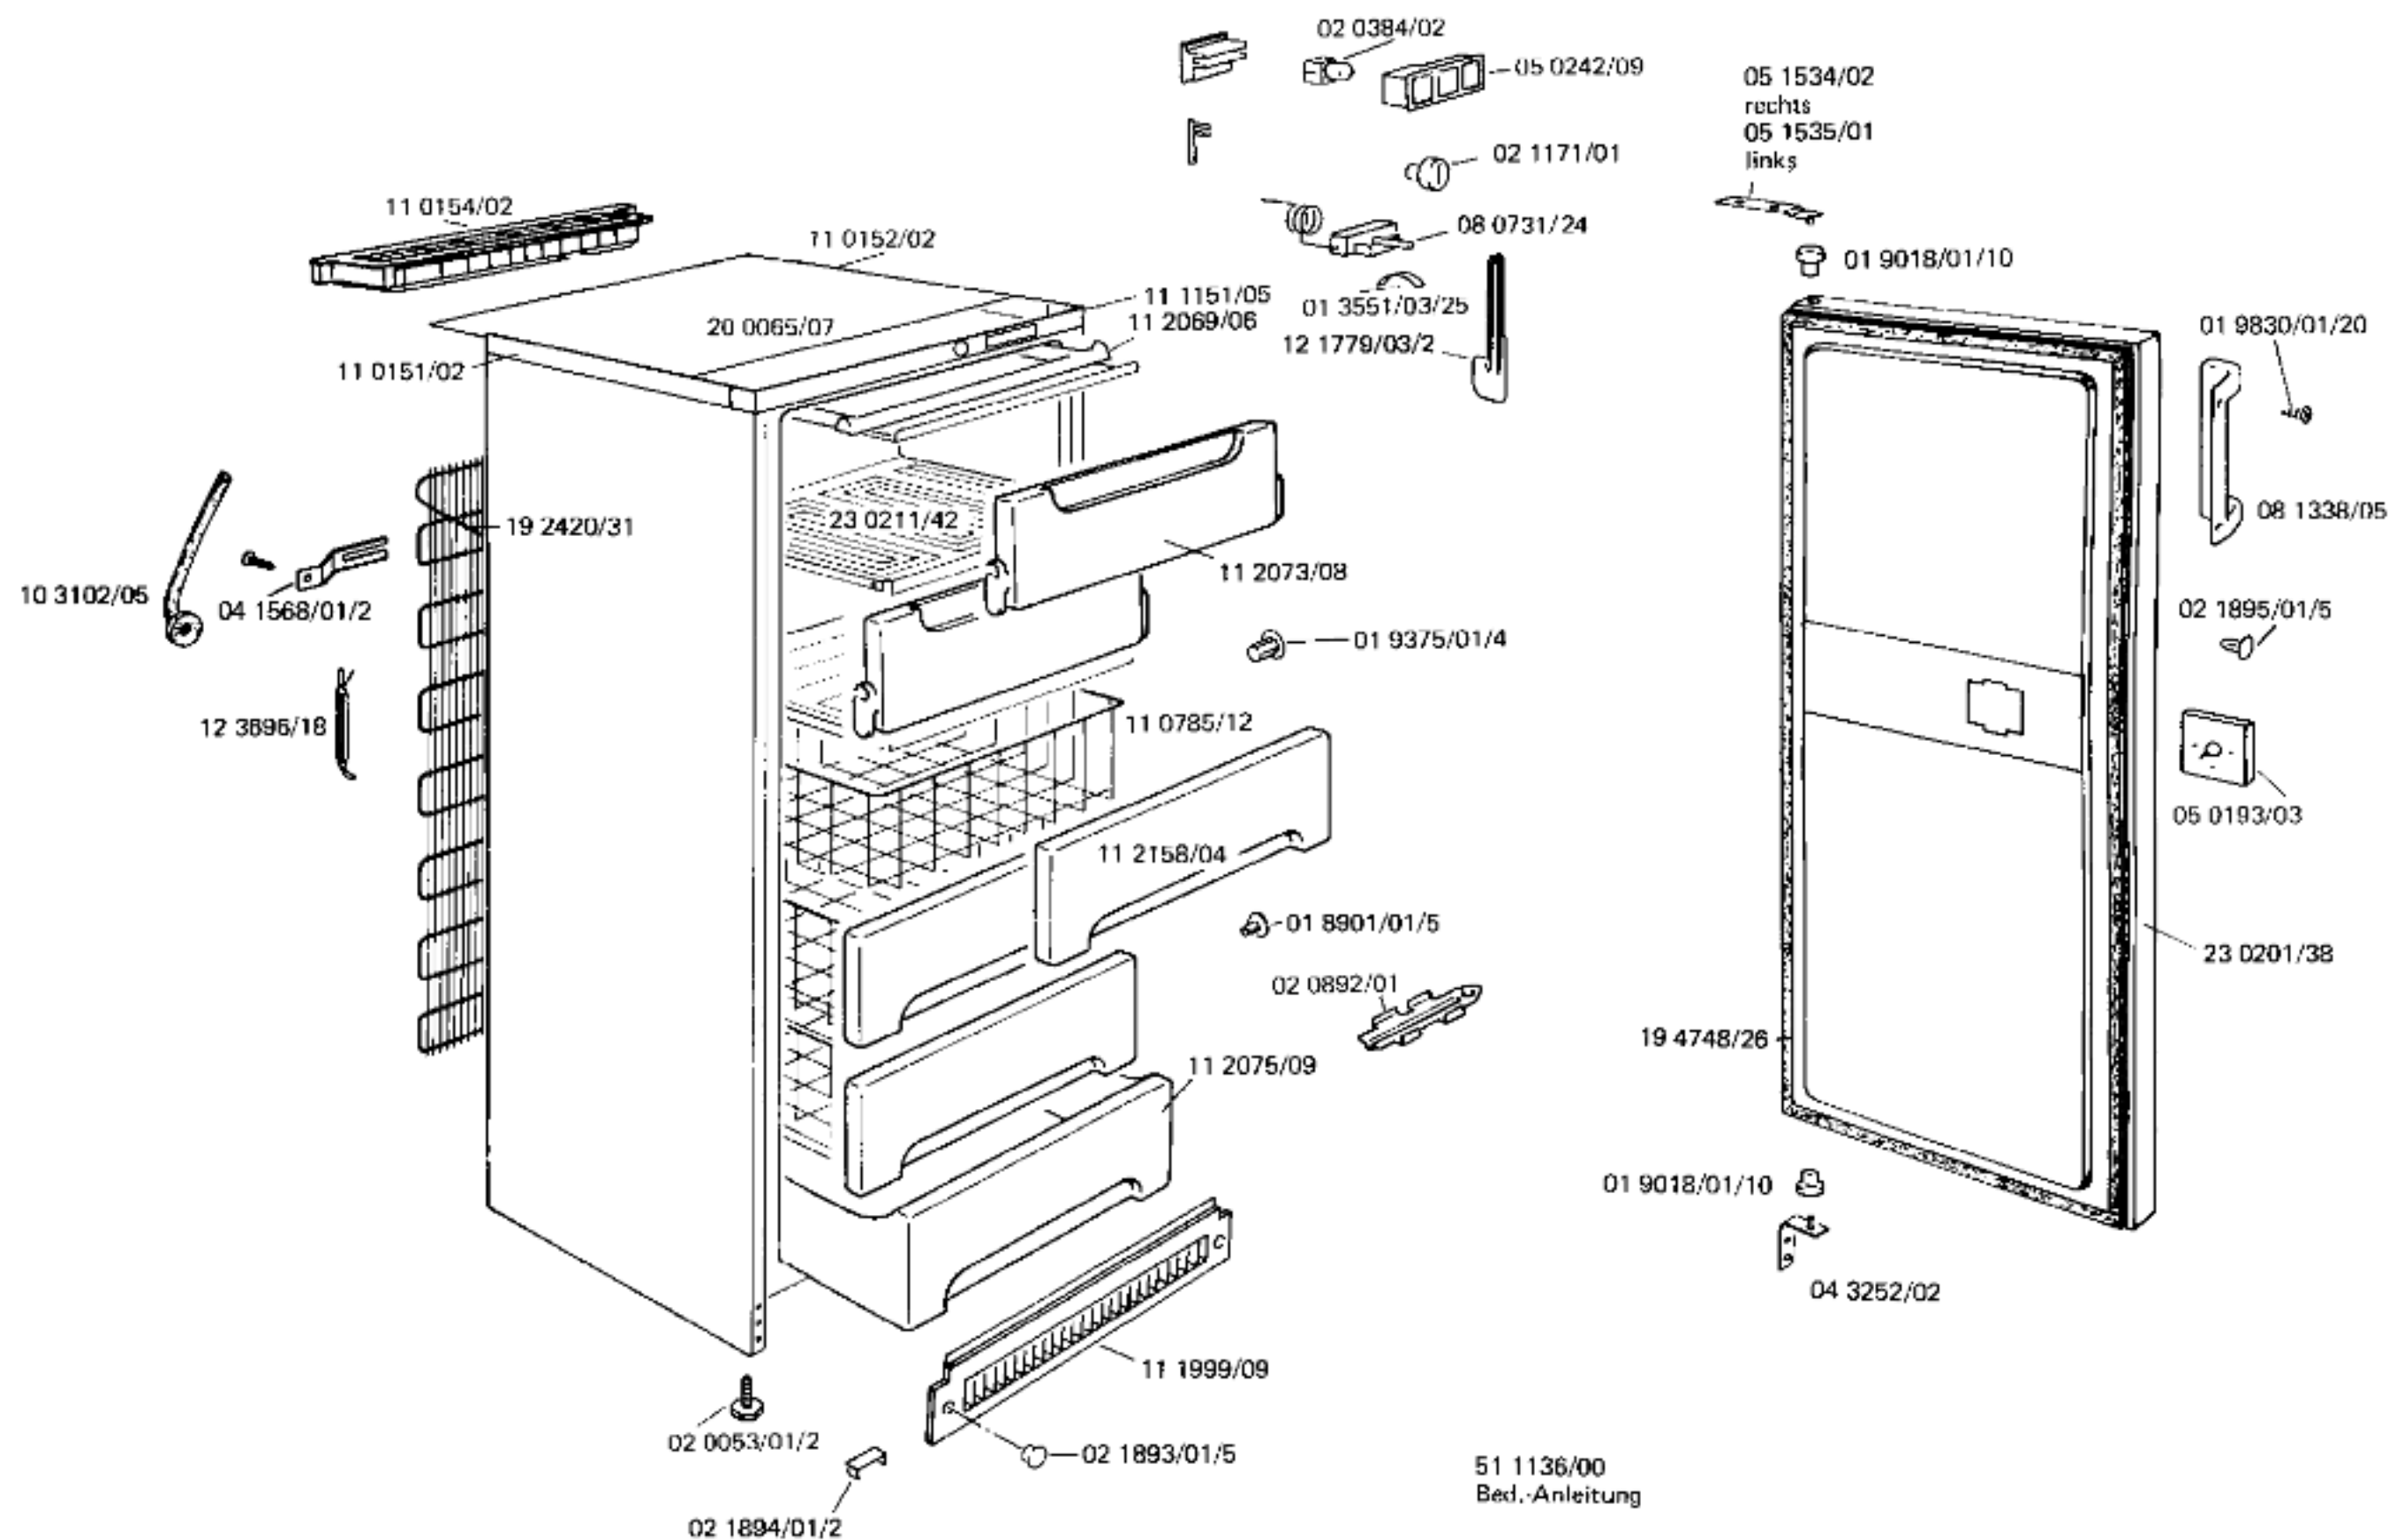

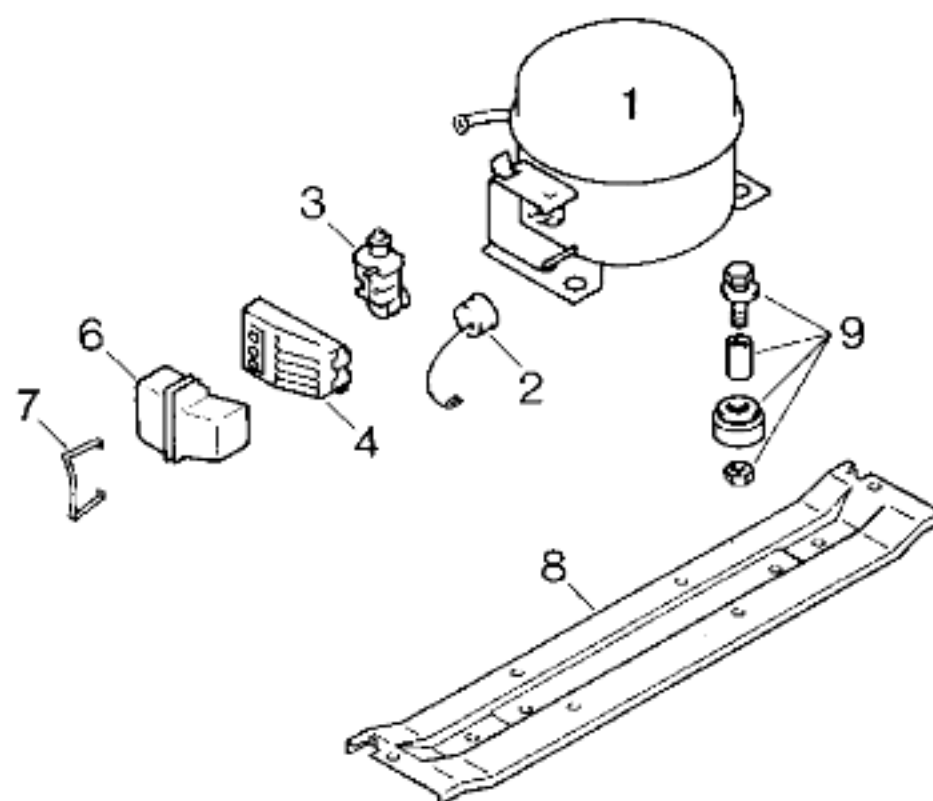

Ausführung	Pos.	D 1, F 1	D 2, F 2			
		Danfoss	Matsushita			
Verdichter	1	14 0023/45	14 0107/44			
Schutzschalter	2	—	02 1733/09			
Anlaufrelais	3	02 0108/27	02 1734/09			
Klemmbrett	4	—	05 1289/14			
Zugentlastung	5	—	—			
Kappe	6	05 1413/05	05 1289/14			
Klammer	7	—	02 1735/01/2			
Tragschiene	8	11 1567/03	—			
Befestigung	9	05 0166/05	—			
Kondensator	10	—	—			
Verdunsterschale	11	—	—			
Befestigung	12	—	—			
Winkel	13	—	—			
Kabelsatz	14	—	—			

TECHNISCHE DATEN

Verdichter Typ Förderleistung l/h Anlaufstrom A Widerstand Ω Ha Hi	Danfoss FR 7,5 A V 1250 9,6 14,5 14,2	Matsushita FN 73 F 13 S V 1310 8,0 11,6 60,6			
Temp.-Regler: Typ Reglerstellung Schaltwerte °C ein: aus: alarm:	Ranco A 56 kalt warm - 26 - 18 - 34 - 24 - 20 - 13				
Füllmenge R 12 g	175				
Anschlußwert W	150				
Heizung: Widerstand Ω Leistung W					
Ventilator: Widerstand Ω					
Magnetventil: Widerstand Ω Spannung V					